

SECURE

SES 302 and SES 303
Temperature & Humidity Sensor



User and Installation Instructions
BGX501-923-02

SES 302 and SES 303

The Secure SES 302 and SES 303 form part of a Z-Wave Plus™ home automation network. The SES 302 measures temperature whilst the SES 303 measures temperature and humidity. The sensors are battery-operated devices which transmit information to an associated device in a network.


The SES 302 and SES 303 are fully compliant Z-Wave Plus™ devices which will work with other manufacturer's Z-Wave devices.

External Pipe and Tank Temperature Sensors (Optional)

The SES 302/303 can support either 1-thermistor (SES 001) or up to 4-external digital temperature sensors (SES 002/003).

Please take note of the following:

1. Refer “Product Ordering Codes” section for order details.
2. The connector for external probes is on the rear wall plate.
3. The connector is only for connecting external sensors.
4. Do not connect to the mains.

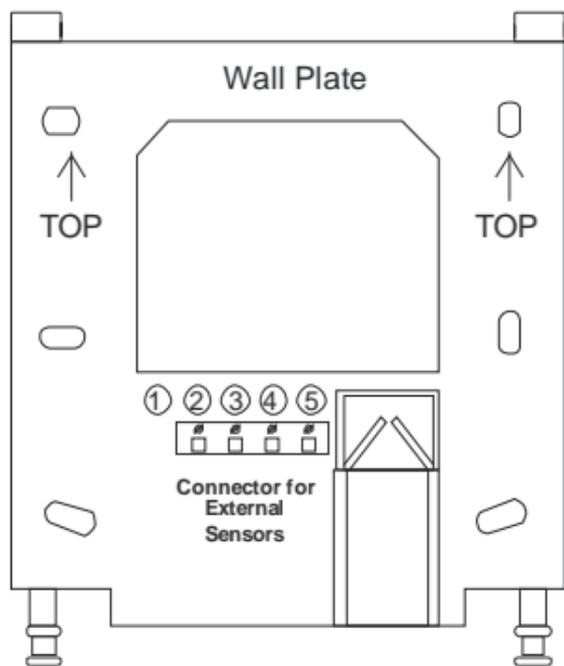



5. Refer to the Pipe/ Tank temperature sensor (SES 00x) manual for the connection diagram.

Installation


Keep the SES 302 / SES 303 in its sealed pack until all dust and debris have been cleared away prior to making connections.

Remove the wall plate from the rear of the SES 302/303.

- a) The wall plate can be released by pressing the spring clips on the bottom of the wall plate
- b) While pressing spring clips, swing the wall plate out and down to remove.

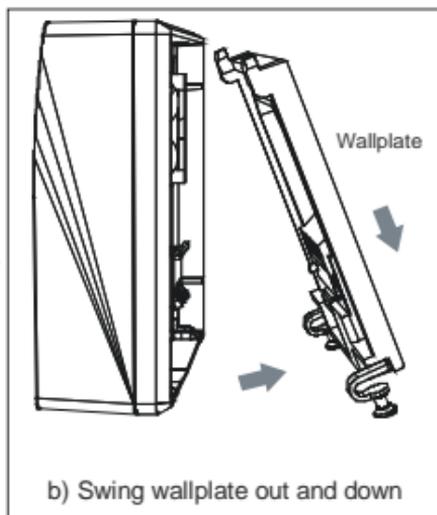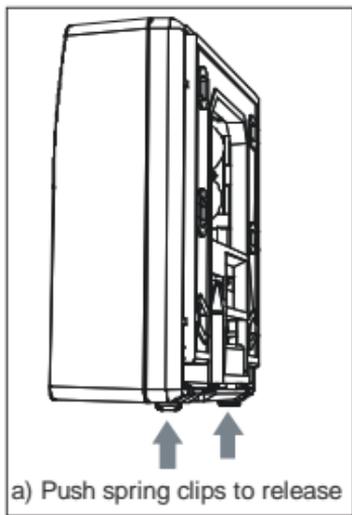

Choose the position where the unit is to be mounted (refer to the following layout).

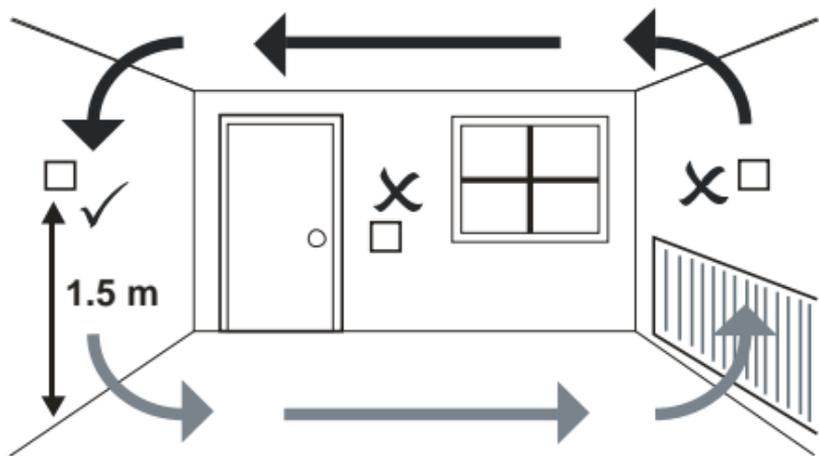

Avoid locations alongside or behind large metal surfaces that could interfere with the low power radio signals between the unit

and the controller. The sensor should be mounted on an internal wall, approximately 1.5 metres (5 feet) above floor level and away from draughts, direct heat sources and sunlight.


Make sure that there will be sufficient space around the unit to allow easy access to the two retaining spring clips on the base of the wall plate.

It may be necessary to move the sensor around to ensure good communication.

Do not attempt to mount it on the wall until it has been included on the network.


Note: Inclusion means add and exclusion means delete.

Including and Excluding a Device

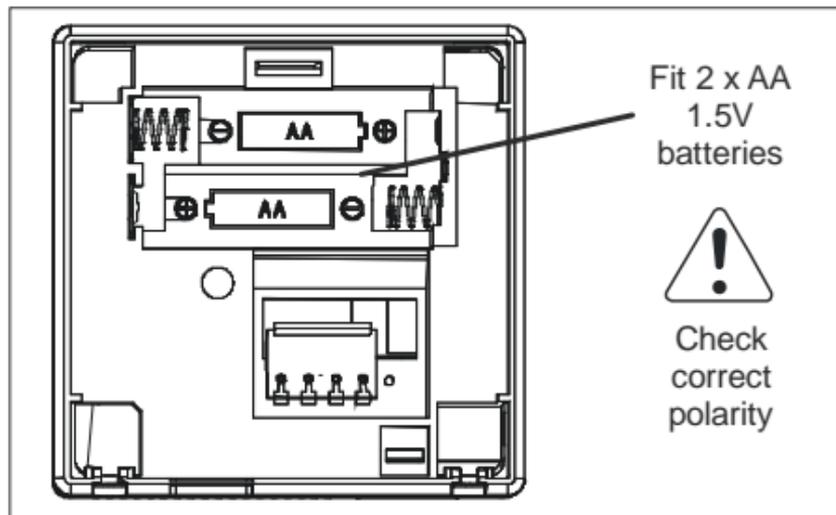

Fit the two supplied AA batteries. The battery compartment is marked with a plus and minus sign. Ensure that each battery is correctly aligned. The SES 302/303 will now power up.

Step 1: On the Z-Wave controller, select Include if you are adding a device to the network or select Exclude if you are removing a device from the network. Check with the controller manufacturer's manual.

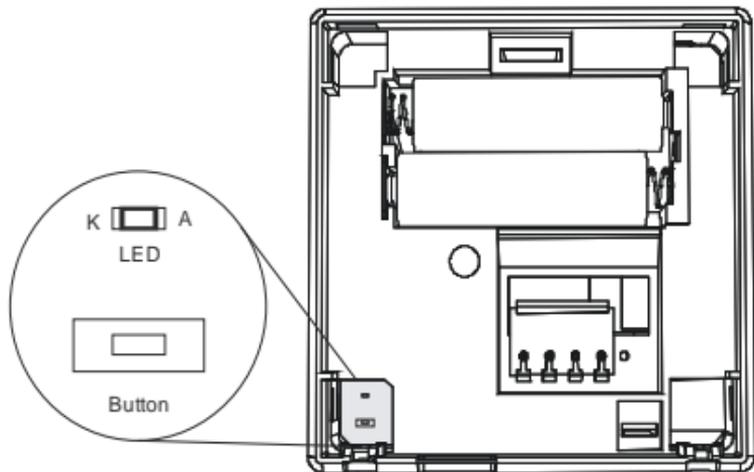

Step 2: On the SES 302 or SES 303, press the button, hold and release after 1 second

to send a request (Network Information Frame) to join the network.

On successful inclusion the LED will flash 2 times.

The total process can take up to 20 seconds; refer to the “Radio” section for details.

If the LED flashes 4-times this means that the inclusion process has failed, so try moving the SES 302/SES 303 to another position and repeat the Inclusion steps. If the inclusion process fails again, the device may be already included in another network. So first exclude and then include the device.

The controller will show when the inclusion/
Exclusion operation is successful.

Associating a Device on a Z-Wave Network

Association process is applicable only after device included onto network) Please note that some controllers can automatically associate. Always check with the manufacturer's manual.

Step 1: Put the controller into Association Mode.

Step 2: Press and hold SES 302/ SES 303 button for more than 1 second and then release.

Step 3: The controller will confirm association when the process is successfully completed.

RF communication check after installation

Press button for less than 1 second. The SES 302/SES 303 will send an onboard temperature report.

Note: this feature only works when the device has been included in network and the nodes associated.

Sending Node Information- Press and hold SES 302/303 button for more than 1 second and then release.

Device Endpoints details

| End Point No. | Reports to the nodes at the Endpoint |
|---------------|--------------------------------------------------------------|
| 1 | Measured Temperature report. |
| | Measure Humidity report. |
| | Low battery Alarm report. |
| 2 | Temperature report external digital sensor 01 or thermistor. |
| 3 | Temperature report external digital sensor 02. |
| 4 | Temperature report external digital sensor 03 |
| 5 | Temperature report external digital sensor 04 |

Technical Information of Z-Wave Plus command classes

| | |
|----------------------------------------------------------------|------------------------------|
| Z-Wave Plus Device Classes | Implemented Device Class |
| Generic | Multilevel sensor |
| Specific | Routing Multilevel sensor |
| Basic | Routing Slave |
| Battery operated devices do not support routing functionality. | |
| Command Class | Commands Supported |
| Multilevel Sensor (V6) | Get |
| | Report |
| Used to report measured sensor values to associated nodes. | |
| Manufacturer Specific (V2) | Manufacturer Specific Get |
| | Manufacturer Specific Report |
| | Device Specific Get |
| | Device Specific Report |

Manufacturer ID = 0x0059
Product Type ID = 0x000D
Product ID = 0x0002 (SES 302)
Product ID = 0x0003 (SES 303)

Version (V2)

Get

Report

Version Command Class Get

Version Command Class
Report

Battery Level (V1)

Get

Report

Battery report is issued on a battery change or when a low-level battery is detected.

Wake Up (V2)

Wake Up Interval Capabilities
Get

Wake Up Interval Capabilities

Wake Up Interval Set

Wake Up Interval Get

Wake Up Interval Report

Wake Up Notification

| | |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------|
| | Wake Up No More Information |
| <p>Wakeup interval step is 60 seconds Minimum wakeup interval is 2 minutes Maximum wakeup interval is 24 hours Default wakeup interval is 24 hours</p> | |
| Association (V2) | Set |
| | Get |
| | Report |
| | Remove |
| | Supported Groupings Get |
| | Supported Groupings Report |
| | Specific Group Get Command |
| | Specific Group Report Command |
| Product supports one group for each end point that have a maximum of 2 nodes. | |
| Multi Channel (V3) | Multi Channel End Point Get |
| | Multi Channel End Point Report |
| | Multi Channel Capability Get |

| | |
|--|-------------------------------------|
| | Multi Channel Capability Report |
| | Multi Channel End Point Find |
| | Multi Channel End Point Find |
| | Multi Channel Command Encapsulation |

Up to a maximum of five end points supported. The number of end points on the product is detected based on the number of external sensors connected to the product at the time of Inclusion.

If external sensor not connected this command class is not supported.

Note: external digital sensors must have correct hardware address otherwise it will not work.

For example: If one external sensor is connected it should have HW address 1. If two external sensors are connected it should have HW address 1 and 2

Note: Refer to the Pipe/Tank temperature sensor (SES 00x) manual for device address setting.

| | |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------|
| Configuration (V1) | Set |
| | Get |
| | Report |
| For configuration details refer to the “Configuration Parameters” section. | |
| Device Locally Reset (V1) | Report |
| Please use this procedure only when the primary controller is missing or otherwise inoperable, to reset the device to factory default press the button 3 times within 3 seconds, that include setting all the configuration, Association to factory default and removing the device from Z-Wave network. | |
| Association Group Info (V1) | Group Name Get |
| | Group Name Report |
| | Group Info get |
| | Group Info Report |
| | Group Command List Get |
| | Group Command List Report |
| Only one association group is supported on each end point and its name is “Lifeline”. | |

Profile MSB -

ASSOCIATION_GROUP_INFO_REPORT_PROFILE_G
ENERAL

Profile LSB -

ASSOCIATION_GROUP_INFO_REPORT_PROFILE_G
ENERAL_NA

Supported Command class and command :

1. COMMAND_CLASS_SENSOR_MULTILEVEL,
SENSOR_MULTILEVEL_REPORT_V6
2. COMMAND_CLASS_BATTERY,
BATTERY_REPORT

| | |
|-----------------------|--------|
| Z-Wave Plus Info (V2) | Get |
| | Report |

Role Type -
 ROLE_TYPE_SLAVE_SLEEPING_REPORTING
 Node Type -
 ZWAVEPLUS_INFO_REPORT_NODE_TYPE_ZWAVEPLUS_NODE
 Installer Icon-
 ICON_TYPE_SPECIFIC_SENSOR_MULTILEVEL_MULTIDEVICE
 User Icon-
 ICON_TYPE_SPECIFIC_SENSOR_MULTILEVEL_MULTIDEVICE

| | |
|------------------|------------------------------|
| Power Level (V1) | Power Level Set |
| | Power Level Get |
| | Power Level Report |
| | Power Level Test Node Set |
| | Power Level Test Node Get |
| | Power Level Test Node Report |

None

Configuration Parameters

| No | Type | Unit | Resolution | Default Value | Supported Endpoints |
|----|-----------------------------|------|------------|---------------|---------------------|
| 1 | Delta Temp | °C | 0.1 | 0°C | 1-5 |
| 2 | Temp Reporting Interval | Mins | 1 | 5 Min | 1-5 |
| 3 | Delta Humidity | RH % | 0.1 | 5 %Rh | 1 |
| 4 | Humidity Reporting Interval | Mins | 1 | 5 Min | 1 |

Common attributes:

Access Types = Read/ Write

Size Bytes = 1, Min Value = 0, Max Value = 255

Zero configuration mean that the corresponding functionality is disabled.

Configuration value = Desired value/ Resolution.

Example: To configure Delta temperature to 2 °C. The value need to configured in device is $2/0.1 = 20$.

IMPORTANT: Controllers may only allow configuring signed values. In order to set values in the range 128...255, the value sent in the application shall be equal to desired value minus 256. For example, to set Delta Temperature to 130, it may be needed to set a value $130-256=-126$.

Note: For more information about Z-Wave command classes and their use refer “SDS12652 Z-Wave Command Class Specification” ver 3 or above and “SDS12657 Z-Wave Command Class Specification” ver 2 or above.

Product Ordering Codes

| | | |
|------------|------------------------------------------------------------|--------------|
| SES 302 | Z-Wave Temperature Sensor | NU2010302000 |
| SES 303 | Z-Wave Temperature and Humidity Sensor | NU2010303000 |
| SES 001 | Thermistor Temperature Sensor with 3m cable | BGX301-536 |
| SES 002 | Digital Pipe & Tank Temperature Sensor with 1m cable | NU5680501000 |
| SES 003 | Digital Pipe & Tank Temperature Sensor with 4m cable | NU5680601000 |

Technical Specifications

Specification applies to both SES 302 and SES 303 unless otherwise stated.

Electrical

Purpose of Control: Electronic Temperature and Humidity Sensor (Independently Mounted)

Software Class: Class A

Battery operated device using two AA batteries.

** Do not use rechargeable batteries**

Each battery: 1.5V

Nominal Life: 2-years with on-board sensors operating with the default configuration.

For 5-years battery life, delta reporting should be zero and no external sensors:

- (1) SES 302: configure >15min reporting interval
- (2) SES 303: configure >1hour reporting interval

Measurement

SES 302:

Temperature Accuracy: $\pm 0.5^{\circ}\text{C}$ for 0°C to 40°C

SES 303:

Temperature Accuracy: $\pm 0.5^{\circ}\text{C}$ for 0°C to 40°C

Humidity Accuracy: $\pm 3\%$ RH for 20% RH to 80% RH

Mechanical

| | |
|---------------------------------|---------------------------------------------|
| Dimensions: | 85x85x30 mm |
| Case Material: | Thermoplastic, flame retardant |
| Mounting | Wall mounting to fit a single gang wall box |
| Weight (single unit packing): | 205 \pm 30 g |
| Ball Pressure Test Temperature: | 75 $^{\circ}\text{C}$ |

After Care: Clean only with a clean damp cloth; do not use any aggressive cleaning agents. If cleaning agents are necessary, check compatibility before use.

Environmental

| | |
|-------------------------------|-----------------|
| Storage temperature: | -20°C to 55°C |
| Operating temperature: | 0°C to 40°C |
| Environmental humidity range: | 0%RH to 95%RH |
| Atmospheric Range: | 980 to 1035 hPa |
| Pollution Degree: | Degree 2 |
| Enclosure protection: | IP30 |

Radio

| | |
|--------------------|---------------------------------|
| Receiver Category: | Category 3 |
| Power Class: | Class B |
| RF frequency | |
| Europe & UK: | 868.42MHz |
| ANZ: | 921.42MHz |
| RF range: | 100m line of sight in open air. |

Inclusion: If the Z-Wave controller does not respond within 2-seconds then the SES will try with NWI (Network Wise Inclusion). The total process can take up to 20 seconds.

This is a Z-Wave certified product and can be used with Z-Wave controllers that support its functionality. Please refer to the documentation provided by the gateway or controller manufacturer. See the Z-Wave alliance website www.z-wavealliance.org for certified controllers.

Compliance



RoHS

IEC 61010-1

R&TTE directive

ETSI EN 300 220-2



European Head Office

Secure Controls (UK) Ltd.
South Bristol Business Park
Roman Farm Road
Bristol, BS4 1UP, UK
e: info@securetogether.com
www.securetogether.com

European Sales Office

CEWE Instrument AB
Box 1006, 611 31 Nyköping
t: +46 8 600 80 60
e: info@securetogether.com
www.securetogether.com

Australia Sales Office

Secure Australasia Pty Ltd

258 Darebin Road

Fairfield VIC 3078

Australia

p: +61 3 9485 6000

f: +61 3 9485 6099

e: info@securetogether.com

www.securetogether.com

Secure Meters Ltd

Pratapnagar Industrial Area

Udaipur 313003

India

p: +91 294 2492 300-05

f: +91 294 2492 310

e: mktg@securetogether.com

www.securetogether.com

Elegant Metering Solutions FZE

4EA 326, P.O. Box 54857

Dubai Airport Free Zone

Dubai, UAE

p: +971 50 6575166

f: +971 04 204 5619

e: emsfze@emsdxb.ae

www.securetogether.com



BGX501 - 923